


Process for Developing Risk Reduction Standards (RRS) at HSRA, Brownfield¹, and VRP² Sites in Georgia

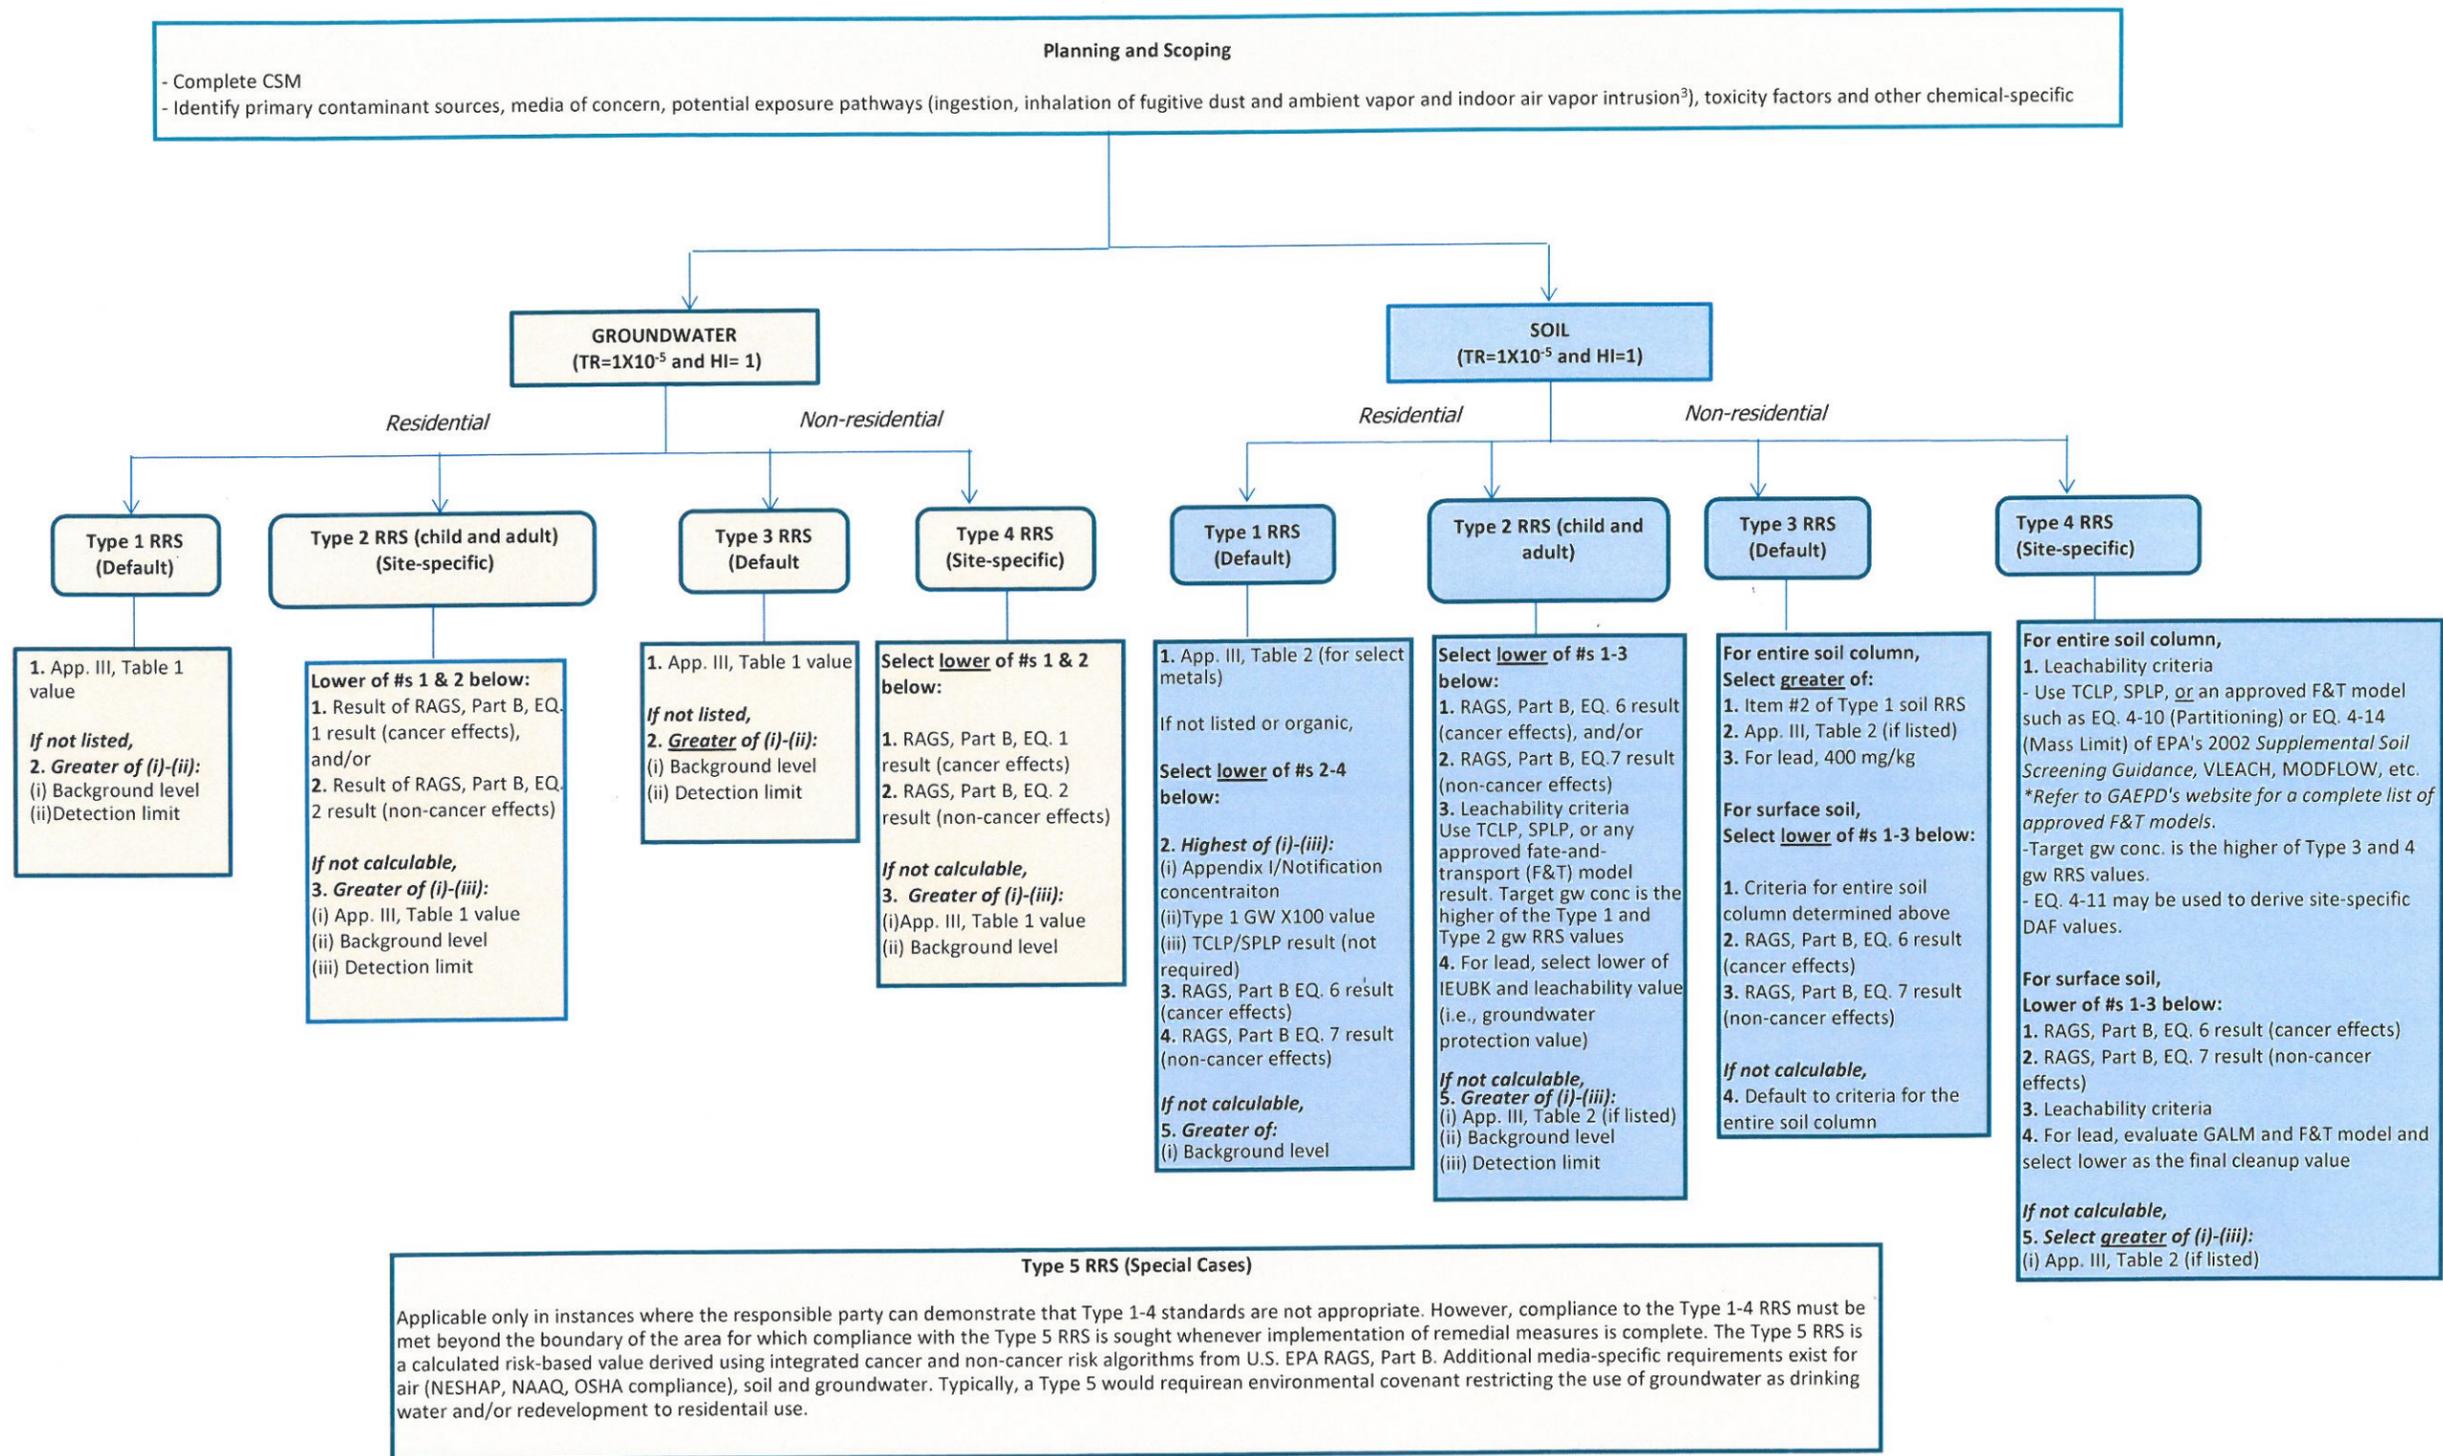

Notes

¹Under Brownfield, qualifying material must comply with the applicable RRS for source material and soil only.

²VRP sites follow the same risk reduction process as HSRA sites.

³Vapor intrusion screening is required for all sites with the potential for indoor air vapor intrusion. Receptors are evaluated under the current and anticipated future land use.